

2019

Bently Nevada 3300/46

Datasheet

Cambia Automation Limited Contact Email: sales@cambia.cn



3300/46 Ramp Differential Expansion Monitor


Bently Nevada™ Asset Condition Monitoring

Description

Many large machines requiring differential expansion monitoring do not have a convenient location for mounting the large proximity probes required to make this important measurement. Extremely large machines may require a monitoring range beyond the linear range of even the largest available transducers. The 3300/46 Ramp Differential Expansion Monitor provides for an alternate measurement technique that allows increased monitoring ranges from standard transducers. It is also extremely useful when conventional methods from a collar are not possible.

Two proximity probes are used to observe ramp surfaces, on the rotor, in order to provide one channel of differential expansion. Using ramp surfaces allows increased monitor range with smaller transducers. The monitor's ability to use ramp surface targets also provides added flexibility when choosing a transducer mounting location.

Both the magnitude and direction of differential expansion are displayed on the LCD. The monitor provides four alarm setpoints (two over and two under alarms).

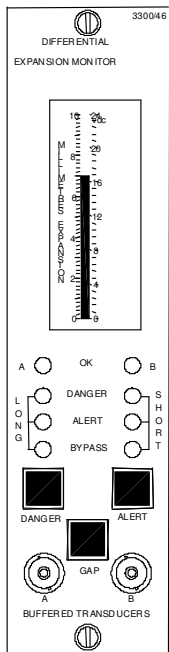

email: sales@cambialtd.com



CAMBIA
AUTOMATION LIMITED

Specifications and Ordering Information
Part Number 141508-01
Rev. F (06/07)

Specifications

Inputs

Signal:

Accepts two proximity probe transducer signals.

Input Impedance:

10 k Ω .

Signal Scale Factor:

100 m/mil (4 V/mm), 20 mV/mil (0.787 V/mm) or
10 mV/mil (3.92 V/mm). Jumper-selectable.

Power Consumption:

Nominal consumption of 1.5 watts.

Signal Conditioning

Accuracy:

Within $\pm 0.33\%$ of full-scale typical, $\pm 1\%$ maximum.
Specified at ambient temperature of $+25^{\circ}\text{C}$ ($+77^{\circ}\text{F}$).

Outputs

Recorder:

User-programmable for +4 mA to +20 mA, 0 to -10 Vdc, or +1 Vdc to +5 Vdc. Voltage or current outputs are proportional to programmed monitor full-scale. A single composite recorder output is provided on Channel A. Monitor operation is unaffected by short circuits on recorder outputs.

Recorder accuracy (in addition to signal conditioning accuracy):

All specified at $+25^{\circ}\text{C}$ ($+77^{\circ}\text{F}$).

- **+4 to +20 mA:** $\pm 0.7\%$ of signal, ± 0.09 mA offset.
- **+1 to +5 Vdc:** $\pm 1.1\%$ of signal, ± 10 mV offset.
- **0 to -10 Vdc:** $\pm 1.1\%$ of signal, ± 15 mV offset.

Output Impedance (voltage outputs):

100 Ω . Minimum load resistance is 10 k Ω .

Voltage Compliance (current outputs):

0 to +12 Vdc range across load. Load resistance is 0 to 600 Ω when using +4 to +20 mA option.

Buffered Transducer Outputs:

One coaxial connector per transducer on the front panel and one terminal connection per channel on the rear panel. All are short circuit protected.

Output Impedance:

100 Ω .

Transducer Supply Voltage:

-24 Vdc voltages are current limited per channel on individual monitor circuit board.

Alarms

Alarm Setpoints:

Both alarms (Alert and Danger) are digitally adjustable from 0 to 100% of full-scale and can be set within LCD resolution ($\pm 1.6\%$ of full-scale) to a desired level. Once set, alarms are repeatable within $\pm 0.4\%$ of full-scale.



Relay Modules

Location:

One relay module can be installed behind each monitor. At least one alarm relay module must be ordered with each 3300 System.

Display

Meter:

Nonmultiplexing vertical bargraph type Liquid Crystal Display (LCD). 63 individual LCD segments per channel. Probe Gap indicated on a center scale. LCD also displays error codes and monitor ADJUST mode.

Resolution:

Within $\pm 1.6\%$ of monitor full-scale.

Size:

83 mm (3.2 in), vertical dimension.

LED Indicators

OK:

One constant ON green LED per channel to indicate OK condition of monitor, transducers, and field wiring. Constant OFF indicates NOT OK condition or channel Bypassed (red Bypass LED will be ON). OK LED flashing at 1 Hz indicates transducer has been NOT OK but is now OK. OK LED flashing at 5Hz indicates error code(s) stored in memory.

Alarm:

Two red LEDs indicate alarm status (individually for Alert and Danger). Flashing alarm LED indicates First Out (independent for Alert and Danger alarms).

Bypass:

Two red LEDs indicate status of Danger Bypass and Rack / Channel Bypass functions.

Environmental Limits

Operating Temperature:

0°C to +65°C (+32°F to +150°F).

Storage Temperature:

-40°C to +85°C (-40°F to +185°F).

Relative Humidity:

To 95%, noncondensing.

CE Mark Directives

EMC Directive

Certificate of Conformity: 158710

Low Voltage Directive

Certificate of Conformity: 135300

Hazardous Area Approvals

CSA/NRTL/C

Class I, Div 2

Groups A, B, C, D

T4 @ Ta = +65 °C

Certification Number

150368 – 1002151 (LR 26744)

ATEX

Ex II 3 G

EEx nC[L] IIC

T4 @ Ta = -20°C to +60°C

When installed per document number 132577-01.

Certification Number

BN26744C-55A



Physical

Space

Requirements:

One rack position (any position except 1 and 2 which are reserved for Power Supply and System Monitor, respectively).

Weight:

Ordering Information

For spares, order the complete catalog number as described below. This includes a front panel assembly, monitor PWAs with sheet metal, and appropriate relay module. This unit is optioned, tested and ready to install in your system. Spare relay modules can be ordered separately.

Ramp Differential Expansion Monitor

3300/46-AXX-BXX-CXX-DXX

Note: The monitor range and ramp angle determine which transducers are compatible for the differential expansion measurement. When selecting the transducer type, refer to Table 1 to verify that it is compatible with the desired meter range and ramp angle.

Option Descriptions

A: Full-scale Range Option

01	5-0-5 mm
02	0-10 mm
03	0.25-0-0.25 in
04	0-0.5 in
05	10-0-10 mm
06	0-20 mm
07	0.5-0-0.5 in
08	0-1.0 in
09	1.0-0-1.0 in
10	0-2.0 in
11	25-0-25 mm
12	0-50 mm

B: Transducer Input Option

01	7200 11 mm (not XL)
02	7200 14 mm or 3300 HTPS or 3300 XL 11 mm
03	25 mm
04	35 mm
05	50 mm

C: Alarm Relay Option

00	No Relays
01	Epoxy-sealed
02	Hermetically-sealed
03	Quad Relay (Epoxy-sealed only)
04	Spare Monitor-No SIM/SIRM

Note: At least one relay module must be ordered with each 3300

System. If one common relay module per system has been ordered, all other monitors of this type will be jumper-programmed at the factory to activate relay bus one.

D: Agency Approval Option

00	Not required
01	CSA/NRTL/C

Note: CSA/NRTL/C option is only available with relays when the monitor is ordered in a system.

Spare Relay Module Assemblies

81544-01

No Relays

81545-01

Dual Epoxy Relays

81546-01

Dual Hermetic Relays

85119-01

Quad Relays

Field-programmable Options

These options are field-programmable via plug-in jumpers. **Bold text** indicates options as shipped from the factory.

First Out Option

Enabled
Disabled

Alarm Time Delay Option

0.1 second
1 second
3 seconds
6 seconds

OK Mode Option

Nonlatching
Latching

Alert Reset Option

Latching
Nonlatching

Danger Reset Option

Specifications and Ordering Information
Part Number 141508-01
Rev. F (06/07)



	Latching Nonlatching	Monitor NOT OK Defeat Disabled Enabled
Recorder Outputs Option	+4 to +20 mA +1 to +5 Vdc 0 to -10 Vdc	Meter Response Time Fast Slow
Alert Relay Mode Option	Normally de-energized Normally energized	Ramp Option Dual Single
Danger Relay Mode Option	Normally de-energized Normally energized	Upscale Direction Option Toward Probe A Away from Probe A
Danger Bypass Switch Option	Disabled Enabled	Ramp Angle Option Programmable for 4 to 45 degrees


email: sales@cambia.a.c



Table and Field wiring diagram

3300/46 Ramp Differential Expansion Monitor

Table 1: Transducer versus Meter/Ramp Ranges			
Meter Range	Ramp Angles for each Transducer Type (in degrees)		
	11 & 14 mm,HTPS	25 & 35 mm	50 mm
5-0-5 mm/0-10 mm	4 - 18	4 - 45	11 - 45
0.25-0-0.25 in/0-0.5 in	4 - 15	4 - 45	11 - 45
10-0-10 mm/0-20 mm	4 - 9	4 - 33	11 - 45
0.5-0-0.05 in/0-1 in	4 - 7	4 - 25	11 - 45
1-0-1 in/0-2 in	NA	4 - 12	11 - 28
25-0-25 mm/0-50 mm	NA	4 - 12	11 - 28
Options shipped from factory	7	12	12

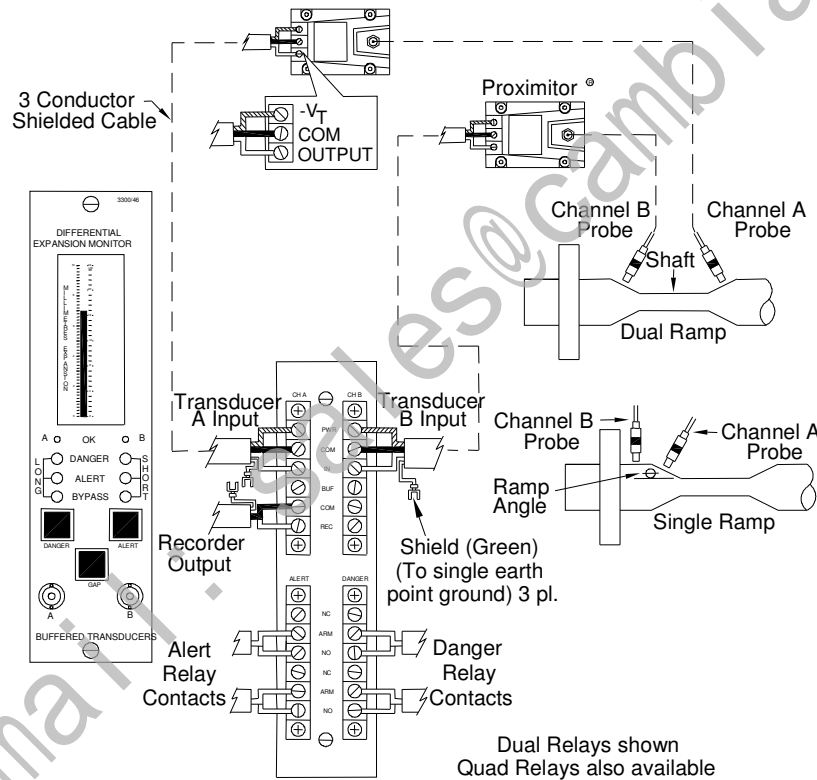

Field wiring diagram for 3300/46 Ramp Differential Expansion Monitor

Bently Nevada is a trademark of General Electric Company.

Copyright 1999 Bently Nevada LLC.
 1631 Bently Parkway South, Minden, Nevada USA 89423
 Phone: 775.782.3611 Fax: 775.215.2873

www.ge-energy.com/bently

All rights reserved.

Specifications and Ordering Information
 Part Number 141508-01
 Rev. F (06/07)



CAMBIA
 AUTOMATION LIMITED