

2019

GE Bently Nevada 3500/61 163179-02

## Datasheet


Cambia Automation Limited    Contact Email: [sales@cambia.cn](mailto:sales@cambia.cn)



# 3500/60 & /61 Temperature Monitors

Bently Nevada\* Asset Condition Monitoring

---

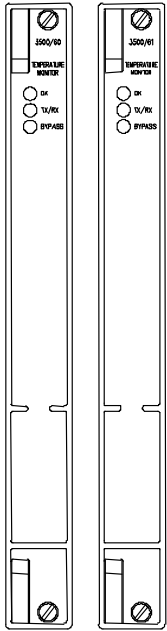

## Description

The 3500/60 & 61 modules provide six channels of temperature monitoring and accept both Resistance Temperature Detector (RTD) and Thermocouple (TC) temperature inputs. The modules condition these inputs and compare them against user-programmable alarm setpoints. The 3500/60 and 3500/61 provide identical functionality except that the 3500/61 provides recorder outputs for each of its six channels while the 3500/60 does not.

The user programs the modules to perform either RTD or TC temperature measurements using the 3500 Rack Configuration Software. Different I/O modules are available in RTD/TC non-isolated or TC isolated versions. The user can configure the RTD/TC non-isolated version to accept either TC or RTD, or a mixture of TC and RTD inputs. The TC isolated version provides 250 Vdc of channel-to-channel isolation to protect against external interference.

When used in a Triple Modular Redundant (TMR) configuration, temperature monitors must be installed adjacent to each other in groups of three. When used in this configuration, the system employs two types of voting to ensure accurate operation and to avoid single-point failures.



Specifications and Ordering Information  
Part Number 141540-01  
Rev. F (06/13)



---

## Specifications

### Inputs

#### Signal

Accepts from 1 to 6 RTD or TC transducer signals.

#### Input Impedance

Greater than 10 M $\Omega$  for each lead input.

#### Power Consumption

**3500/60:** Nominal consumption of 7 watts.

**3500/61:** Nominal consumption of 9 watts.

### Transducers

#### TCs

**Type E:** -100 °C to +1000 °C,  
(-148 °F to +1832 °F).

**Type J:** 0 °C to +760 °C,  
(+32 °F to +1400 °F).

**Type K:** 0 °C to +1370 °C,  
(+32 °F to +2498 °F).

**Type T:** -160 °C to +400 °C,  
(-256 °F to +752 °F).

#### RTDs

**100 $\Omega$  3-wire & 4-wire platinum RTD (alpha = 0.00385):**

\*\* -200° C to +850° C  
(-328 °F to +1562 °F).

With external barriers:

-50 °C to +850 °C

(-122 °F to +1562 °F).

**100 $\Omega$  3-wire & 4-wire platinum RTD (alpha = 0.00392):**

\*\* -200 °C to +700 °C

(-328 °F to +1292 °F).

With external barriers:

-50 °C to +850 °C

(-122 °F to +1562 °F).

**120 $\Omega$  3-wire & 4-wire nickel RTD:**

-80 °C to +260 °C

(-112 °F to +500 °F).

**10 $\Omega$  3-wire & 4-wire copper RTD:**

\*\* -100 °C to +260 °C,

(-148 °F to +500 °F).

With external barriers:

-50 °C to +850 °C

(-122 °F to +1562 °F).

---

**Note:** Platinum RTD's with 0.00385 alphas are the worldwide industrial standard and are recommended for all applications.

\*\* Lower OK limit with external barriers is -50°C.

---

### I/O Modules

Isolated TC I/O modules have 250 Vdc of isolation between channels.

---

### Outputs

#### Front Panel LEDs

##### OK LED

Indicates when the Temperature Monitor is operating properly.

##### TX/RX LED

Indicates then the Temperature Monitor is communicating with other modules in the 3500 rack.

##### Bypass LED

---

Specifications and Ordering Information  
Part Number 141540-01  
Rev. F (06/13)

	Indicates when the Temperature Monitor is in Bypass Mode.		Standard Rack: $\pm 3$ °C at 25 °C ( $\pm 5.4$ °F at 77 °F).
<b>RTD Current Source Value</b>	925 $\pm$ 15 $\mu$ A @ 25° C per transducer (single supply for the 4-wire RTD and two supplies for the 3-wire).	<i>External Termination Non-Isolated:</i>	Bulkhead Rack: $\pm 3$ °C at 25 °C ( $\pm 5.4$ °F at 77 °F).
<b>Recorder</b>	+4 to +20 mA. Values are proportional to monitor full-scale. Individual recorder values are provided for each channel. Monitor operation is unaffected by short circuits on recorder outputs.	<i>Internal Termination Isolated:</i>	Standard Rack: $\pm 1$ °C at 25 °C ( $\pm 1.8$ °F at 77 °F). Bulkhead Rack: $\pm 2$ °C at 25 °C ( $\pm 3.6$ °F at 77 °F).
<b>Voltage Compliance (current output)</b>	0 to +12 Vdc range across load. Load resistance is 0 to 600 $\Omega$ .		Standard Rack: $\pm 3$ °C at 25 °C $\pm 5.4$ °F at 77 °F).
<b>Resolution</b>	0.3662 $\mu$ A per bit $\pm 0.15\%$ error at room temperature $\pm 0.4\%$ error over temperature range.	<i>External Termination Isolated:</i>	Bulkhead Rack: $\pm 1$ °C at 25 °C ( $\pm 1.8$ °F at 77 °F).
<b>Signal Conditioning</b>			Standard Rack: $\pm 1$ °C at 25 °C ( $\pm 1.8$ °F at 77 °F).
	Note: Specified at +25 °C (+77 °F) unless otherwise noted.		
	Full-scale range for each channel is set in the field via 3500 Configuration Software. No calibration is required.	<b>10<math>\Omega</math> Copper RTDs</b>	
<b>RTDs and TCs (except for 10<math>\Omega</math> Copper RTDs)</b>		<b>Resolution</b>	1°C or 1 °F
<b>Resolution</b>	1 °C or 1 °F	<b>Accuracy</b>	$\pm 3$ °C at 25 °C ( $\pm 5.4$ °F at 77 °F).
<b>Accuracy</b>		<b>Cold Junction Compensation Sensor (used for TC measurements)</b>	
<i>Internal Termination Non-Isolated</i>	Bulkhead Rack $\pm 3$ °C at 25 °C ( $\pm 5.4$ °F at 77 °F).	<b>Accuracy</b>	$\pm 1$ °C at 25 °C

(±1.8 °F at 77 °F).

indicate the minimum alarm time delay based on the channel loading.

## Alarms

### Alarm Setpoints

The user can set Alert and Danger setpoints for the value measured by the monitor using software configuration. Alarms are adjustable from 0 to 100% of full-scale for each measured value. The exception is when the full-scale range exceeds the range of the sensor. In this case, the range of the sensor will limit the setpoint. Accuracy of alarms are to within 0.13% of the desired value. The Temperature Monitors have both under and over alarm setpoints.

### Alarm Time Delays

The user can program alarm delays using software as follows:

#### Alert

From 1 to 60 seconds in 1 second intervals.

#### Danger

From 1 to 60 seconds in 0.5 second intervals or can be set to the minimum alarm delay.

Number of actual channel(s)	Minimum time delay (mS)
1	225
2	300
3	375
4	450
5	525
6	600

**Note:** 225 ms alarm time delays will not be available for all channels. As more channels are used the alarm time delay increases. The configuration software will

## Proportional Values

*Proportional values are temperature measurements used to monitor the machine. The Temperature Monitors return temperature proportional values.*

## Environmental Limits

### Operating Temperature

-30 °C to +65 °C (-22 °F to +150 °F) when used with Internal/External Termination I/O Modules  
0 °C to +65 °C (32 °F to +150 °F) when used with Internal Barrier I/O Modules (Internal Termination).

### Storage Temperature

-40 °C to +85 °C (-40 °F to +185 °F).

## Compliance and Certifications

### EMC

Standards:  
EN 61000-6-2 Immunity for Industrial Environments  
EN 55011/CISPR 11 ISM Equipment  
EN 61000-6-4 Emissions for Industrial Environments

European Community Directives:  
EMC Directive 2004/108/EC

### Electrical Safety

Standards:  
EN 61010-1

European Community Directives:  
2006/95/EC Low Voltage

---

## Hazardous Area Approvals

### North American

#### Approval Option (01)

When used with I/O module ordering options with internal barriers:

Ex nC [ia] IIC: Class I, Div 1  
AEx nC [ia] IIC: Class 1, Zone 2/0  
Groups A, B, C, D  
T4 @ Ta = -20 °C to +65 °C  
(-4 °F to +150 °F)  
per drawing 138547

When used with I/O module ordering options without internal barriers:


Ex nC [L] IIC: Class I, Div 2  
AEx nC IIC: Class 1, Div 2  
Groups A, B, C, D  
T4 @ Ta = -20 °C to +65 °C  
(-4 °F to +150 °F)  
per drawing 149243

### ATEX


#### Approval Option (02)

#### For Selected Ordering Options with ATEX/CSA agency approvals:

For ATEX agency approval ordering options with internal barriers:

 II 3/(1) G  
Ex nC[ia Ga] IIC T4 Gc  
T4 @ Ta = -20°C to +65°C  
(-4°F to +150°F)

For ATEX agency approval ordering options without internal barriers:

 II 3/(3) G  
Ex nC[nL Gc] IIC T4 Gc

T4 @ Ta = -20°C to +65°C  
(-4°F to +150°F)

### Brazil

#### Approval Option (02)

**This is for the 3500/61 only  
For Selected Ordering Options  
with ATEX/North American  
agency approvals:**

BR-Ex nC[nL] IIC T4  
T4 @ Ta = -20 °C to +65 °C  
(-4 °F to +150 °F)

### South Africa

#### Approval Option (02)

**For Selected Ordering Options  
with ATEX/North American  
agency approvals:**

Ex nCAL [ia] IIC T4  
Ex nCAL [L] IIC T4  
T4 @ Ta = -20 °C to +65 °C  
(-4 °F to +150 °F)

For further certification and approvals information please visit the following website:  
[www.ge-mcs.com/bently](http://www.ge-mcs.com/bently)

---

**Note:** When used with Internal Barrier I/O Module, refer to specification sheet 141495-01 for approvals information.

---

## Physical

### Monitor Module

#### Dimensions (Height x Width x Depth)

241.3 mm x 24.4 mm x 241.8 mm  
(9.50 in x 0.96 in x 9.52 in).

#### Weight

0.91 kg (2.0 lbs.).

**Note:** External Termination Blocks cannot be used with Internal Termination I/O modules.

**I/O Modules**

**Dimensions  
(Height x Width  
x Depth)**

241.3 mm x 24.4 mm x 99.1 mm  
(9.50 in x 0.96 in x 3.90 in).

**Weight**

0.45 kg (1.0 lbs.).

When ordering I/O Modules with External Terminations the External Termination Blocks and Cables must be ordered separately.

**Internal Barrier  
I/O Module**

Consult the 3500 Internal Barrier specification sheet (part number 141495-01) if the Internal Barrier Option is selected.

**Internal Barrier  
I/O Module**

**Dimensions  
(Height x Width  
x Depth)**

241.3 mm x 24.4 mm x 163.1 mm  
(9.50 in x 0.96 in x 6.42 in).

**Weight**

0.46 kg (1.01 lbs.).

**Ordering Information**

**No Recorder Outputs  
3500/60-AXX-BXX**

**A: I/O Module Type**

- 01** RTD/TC Non-isolated with Internal Terminations
- 02** RTD/TC Non-isolated with External Terminations
- 03** TC Isolated with Internal Terminations
- 04** TC Isolated with External Terminations
- 05** RTD/TC Non-isolated with Internal Barriers and Internal Terminations

**Rack Space Requirements**

**Monitor Module**

1 full-height front slot.

**I/O Modules**

1 full-height rear slot.

**B: Agency Approval Option**

- 00** None
- 01** CSA/NRTL/C (Class 1, Div 2)
- 02** ATEX/CSA (Class 1, Zone 2)

**Note:** Agency Approval Option B 02 is only available with Ordering Options A 01, A 03, and A 05.

**Ordering Considerations**

**General**

If the 3500/60 or 3500/61 is added to an existing 3500 System the following firmware and software versions (or later) are required:

3500/20 Module Firmware – Revision G

3500/01 Software – Version 2.00

3500/02 Software – Version 2.00

**Recorder Outputs  
3500/61-AXX-BXX**

**A: I/O Module Type**

- 01** RTD/TC Non-isolated with Internal Terminations

- 02 RTD/TC Non-isolated with External Terminations
- 03 TC Isolated with Internal Terminations
- 04 TC Isolated with External Terminations
- 05 RTD/TC Non-isolated with Internal Barriers and Internal Terminations

**B: Agency Approval Option**

- 00 None
  - 01 CSA/NRTL/C (Class 1, Div 2)
  - 02 ATEX/CSA (Class 1, Zone 2)
- Note:** Agency Approval Option B 02 is only available with Ordering Options A 01, A 03, and A 05.

**A: Cable Length**

- 0005 5 feet (1.5 metres)
- 0007 7 feet (2.1 metres)
- 0010 10 feet (3.0 metres)
- 0025 25 feet (7.5 metres)
- 0050 50 feet (15 metres)
- 0100 100 feet (30.5 metres)

**B: Assembly Instructions**

- 01 Not assembled
- 02 Assembled

---

**External Termination Blocks**

**133908-01**

RTD/TC Non-Isolated External Termination Block (Terminal Strip connectors).

**133916-01**

RTD/TC Non-Isolated External Termination Block (Euro Style connectors).

**133924-01**

TC Isolated External Termination Block (Terminal Strip connectors).

**133932-01**

TC Isolated External Termination Block (Euro Style connectors).

**133892-01**

3300/61 Recorder Output External Termination Block (Terminal Strip connectors).

**133900-01**

3300/61 Recorder Output External Termination Block (Euro Style connectors).

---

**3500/61 Recorder Output to External Termination (ET) Block Cable**

**134543- AXX - BXX**

**A: Cable Length**

- 0005 5 feet (1.5 metres)
- 0007 7 feet (2.1 metres)
- 0010 10 feet (3.0 metres)
- 0025 25 feet (7.5 metres)
- 0050 50 feet (15 metres)
- 0100 100 feet (30.5 metres)

**B: Assembly Instructions**

- 01 Not assembled
- 02 Assembled

---

**Spares**

**Shared components**

**133908-01**

RTD/TC Non-Isolated External Termination Block (Terminal Strip connectors).

**133916-01**

RTD/TC Non-Isolated External Termination Block (Euro Style connectors).

**133924-01**

TC Isolated External Termination Block (Terminal Strip connectors).

**133932-01**

TC Isolated External Termination Block (Euro Style connectors).

**00580442**

Connector Header, Internal Termination, 9-position, Green.

**00580443**

---

**Cables**


**3500/60 and 3500/61 Transducer (XDCR) Signal to External Termination (ET) Block Cable**

**134544-AXXXX-BXX**




	Connector Header, Internal Termination, 12-position, Green.	<b>136711-01</b>	
<b>00502133</b>			3500/60 RTD/TC I/O Module with Internal Barriers and Internal Terminations. (Not-Isolated)
	Connector Header, Internal Termination, 12-position, Blue.		
<b>00580444</b>		<b>3500/61-Specific</b>	
	Connector Header, Internal Termination, 15-position, Green.	<b>133811-02</b>	
<b>04425545</b>			3500/61 Monitor (Replaced by PN 163179-02).
	Grounding Wrist Strap (single use).	<b>135343-01</b>	
<b>04400037</b>			Firmware IC
	IC Removal Tool.	<b>133819-02</b>	
<b>134542-01</b>			3500/61 RTD/TC Non-Isolated I/O Module Internal Terminations.
	3500/60 & 3500/61 Manual.	<b>133827-02</b>	
			3500/61 RTD/TC Non-Isolated I/O Module External Terminations.
<b>3500/60-Specific</b>			
<b>133811-01</b>		<b>133835-02</b>	
	3500/60 Monitor (Replaced by PN 163179-01).		3500/61 TC Isolated I/O Module Internal Terminations.
<b>135344-01</b>		<b>133843-02</b>	
	Firmware IC.		3500/61 TC Isolated I/O Module External Terminations.
<b>133819-01</b>		<b>133892-01</b>	
	3500/60 RTD/TC Non-Isolated I/O Module Internal Terminations.		3500/61 Recorder Output External Termination Block (Terminal Strip connectors).
<b>133827-01</b>		<b>133900-01</b>	
	3500/60 RTD/TC Non-Isolated I/O Module External Terminations.		3500/61 Recorder Output External Termination Block (Euro Style connectors).
<b>133835-01</b>			
	3500/60 TC Isolated I/O Module Internal Terminations.	<b>136711-02</b>	
<b>133843-01</b>			3500/61 RTD/TC I/O Module with Internal Barriers and Internal Terminations. (Not-Isolated)
	3500/60 TC Isolated I/O Module External Terminations.		

## Figures and Tables

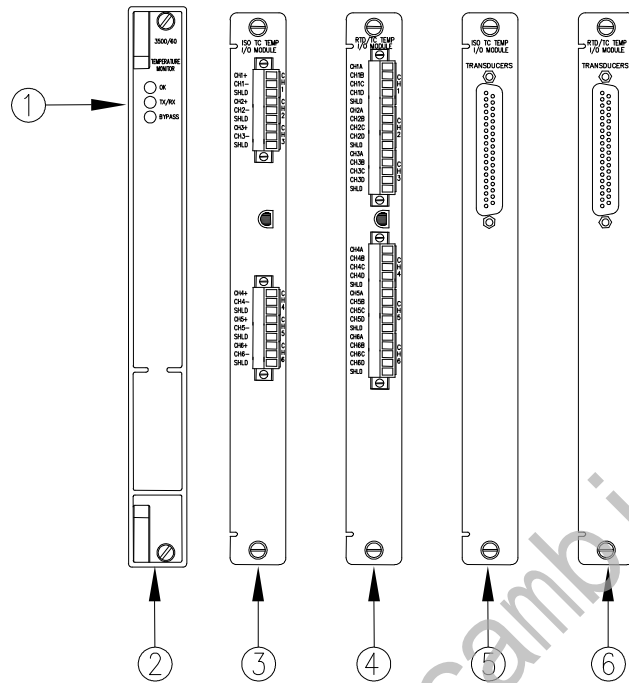

- 1) Status LEDs
  - 2) 3500/60 Main Module Front View
  - 3) ISO TC Temp I/O Module (Internal Terminations)
  - 4) RTD/TC Temp I/O Module (Internal Terminations)
  - 5) ISO TC Temp I/O Module (External Terminations)
  - 6) RTD/TC Temp I/O Module (External Terminations)
- ( No Recorder Outputs)

**Figure 1: Front and rear views of the 3500/60 Temperature Monitor**

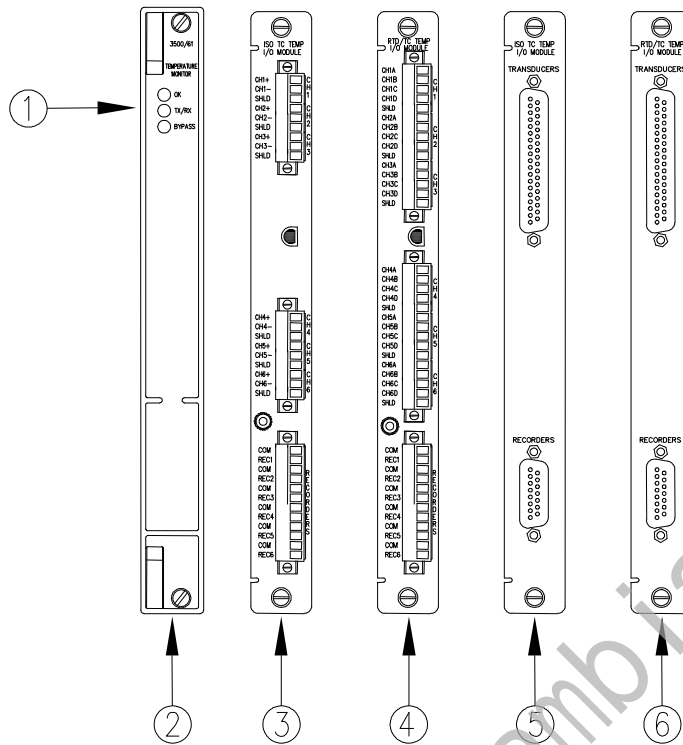

- 1) Status LEDs
  - 2) 3500/61 Main Module Front View
  - 3) ISO TC Temp I/O Module (Internal Terminations)
  - 4) RTD/TC Temp I/O Module (Internal Terminations)
  - 5) ISO TC Temp I/O Module (External Terminations)
  - 6) RTD/TC Temp I/O Module (External Terminations)
- ( Recorder Outputs )

**Figure 2: Front and rear views of the 3500/61 Temperature Monitor**

\* Denotes a trademark of Bently Nevada, Inc., a wholly owned subsidiary of General Electric Company.

© 1999 – 2013 Bently Nevada, Inc. All rights reserved.

Printed in USA. Uncontrolled when transmitted electronically.

1631 Bently Parkway South, Minden, Nevada USA 89423

Phone: 775.782.3611 Fax: 775.215.2873

[www.ge-mcs.com/bently](http://www.ge-mcs.com/bently)