

# Guangzhou Goodsense Decoration Building Materials Co., Ltd.

## TEST REPORT

**REPORT NUMBER**

181030002SHF-001-R1

**ISSUE DATE**

2018/11/16

**REVISE DATE**

2018/12/20


**PAGES**

6

**DOCUMENT CONTROL NUMBER**

LFT-APAC-SHF-OP-10k

© 2018 INTERTEK

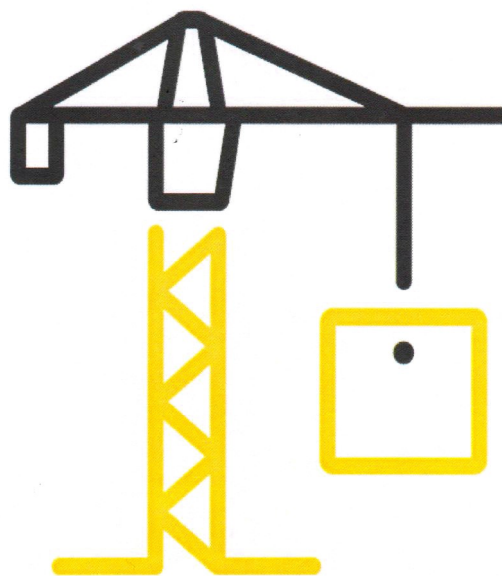

## Test Report

Issue Date: 2018/12/20

Intertek Report No. 181030002SHF-001-R1

Applicant: Guangzhou Goodsense Decoration Building Materials Co., Ltd.

Applicant Address: No. 2, Yanjiang road, huadu district, Guangzhou, Guangdong province

Attn: Hua Du

**SUBJECT:** Performance testing  
Three-dimensional composite aluminum plate

Dear Sir,

This test report represents the results of our evaluation of the above referenced product(s) to the requirements contained in the following standards:

TEST METHODS AND STANDARDS	
Refer to the next following Pages.	

SAMPLE ID	MODEL	SPECIFICATION
S181030002SHF.001~002	9901	4.0*0.48 Brand: GOODSENSE

SAMPLE RECEIVED: 2018/10/29

TESTED FROM: 2018/10/30 TO 2018/11/16

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.



## Test Report

Issue Date: 2018/12/20

Intertek Report No. 181030002SHF-001-R1

### Test Items, Method and Results:

Test method: EN 13501-1:2007+A1:2009 Fire classification of construction products and building elements - Part 1: Classification using data from reaction to fire tests

#### 1.1 HEAT OF COMBUSTION TEST

The test was conducted in accordance with EN ISO 1716. This test evaluates the gross heat of combustion ( $Q_{PCS}$ ) of products at constant volume in a bomb calorimeter.

#### 1.2 SINGLE BURNING ITEM TEST

The test was conducted in accordance with EN 13823. This test evaluates the potential contribution of a product to the development of a fire, under a fire situation simulating a single burning item near to the product.

#### 1.3 CLASSIFICATION CRITERIA

The classification was determined in accordance with EN 13501-1:2007+A1:2009. The class A2 with its corresponding fire performance is given in the table below.

Table - Class of reaction to fire performance for construction products excluding floorings and linear pipe thermal insulation products.

Class	Test Method(s)	Classification criteria	Additional classifications
A2	EN ISO 1716 and	$PCS \leq 3.0 \text{ MJ/kg}^a$ and $PCS \leq 4.0 \text{ MJ/m}^2^b$ and $PCS \leq 4.0 \text{ MJ/m}^2^c$ and $PCS \leq 3.0 \text{ MJ/kg}^d$	--
	EN 13823	$FIGRA \leq 120 \text{ W/s}$ and $LFS < \text{edge of specimen}$ and $THR_{600s} \leq 7.5 \text{ MJ}$	Smoke production <sup>e</sup> and Flaming droplets/particles <sup>f</sup>

#### Note:

- For homogeneous products and substantial components of non-homogeneous products.
- For any external non-substantial component of non-homogeneous products.
- For any internal non-substantial component of non-homogeneous products.
- For the product as a whole.
- In the last phase of the development of the test procedure, modifications of the smoke measurement system have been introduced, the effect of which needs further investigation. This may result in a modification of the limit values and/or parameters for the evaluation of the smoke production.  
 $s1 = \text{SMOGRA} \leq 30 \text{ m}^2/\text{s}^2$  and  $\text{TSP}_{600s} \leq 50 \text{ m}^2$ ;  $s2 = \text{SMOGRA} \leq 180 \text{ m}^2/\text{s}^2$  and  $\text{TSP}_{600s} \leq 200 \text{ m}^2$ ;  $s3 = \text{not } s1 \text{ or } s2$ .
- $d0 = \text{no flaming droplets/particles in EN 13823 within 600s}$ ;  
 $d1 = \text{no flaming droplets/particles persisting longer than 10s in EN 13823 within 600s}$ ;  
 $d2 = \text{not } d0 \text{ or } d1$ .

## Test Report

Issue Date: 2018/12/20

Intertek Report No. 181030002SHF-001-R1

### Test Items, Method and Results:

### 2 RESULTS AND OBSERATIONS

Method	Parameter		Result
EN ISO 1716:2010	PCS	Facing coating, MJ/m <sup>2</sup>	0.4
		Aluminium substrate, MJ/kg	0
		Adhesive film, MJ/m <sup>2</sup>	2.1
		Core material, MJ/kg	0
		Adhesive film, MJ/m <sup>2</sup>	2.1
		Aluminium substrate, MJ/kg	0
		Bottom coating, MJ/m <sup>2</sup>	0.1
		The whole product, MJ/kg	1.3
EN 13823:2010+A1:2014 *	FIGRA <sub>0.2MJ</sub> , W/s		0
	THR <sub>600s</sub> , MJ		0.4
	LFS, m		<Edge of specimen
	SMOGR <sub>A</sub> , m <sup>2</sup> /s <sup>2</sup>		0
	TSP <sub>600s</sub> , m <sup>2</sup>		22
	Flaming droplets/particles		No flaming droplets/particles occur within 600s

#### Note

1. Test item marked with \* was conducted at the external approved facility, located at Guangzhou.
2. Per EN 13823, the samples were free standing at a distance of 80mm from the backing board. Backing board was a 12mm thick calcium silicate board. The density of the calcium silicate board was 900kg/m<sup>3</sup>.
3. The information of each component of the product was declared by applicant, see below table.

Layer No. (from face to back)	Material of each Layer	Mass per unit area (kg/m <sup>2</sup> )	Thickness (mm)
1	Facing coating	0.0338	0.025
2	Aluminium substrate	1.3100	0.480
3	Adhesive film	0.0465	0.050
4	Core material	0.7600	2.850
5	Adhesive film	0.0465	0.050
6	Aluminium substrate	1.3100	0.480
7	Bottom coating	0.0160	0.080



## Test Report

Issue Date: 2018/12/20

Intertek Report No. 181030002SHF-001-R1

### 3 CLASSIFICATION

The classification has been carried out in accordance with EN 13501-1.

Fire behaviour		Smoke production		Flaming Droplets
A2	- s	1	- d	0

Reaction to fire classification: A2 - s1, d0

### 4 Test Photos of EN 13823



Before test (Long wing)



Before test (Short wing)



After test (Long wing)



After test (Short wing)



## Test Report


Issue Date: 2018/12/20

Intertek Report No. 181030002SHF-001-R1

### APPENDIX: SAMPLE RECEIVED PHOTO



Front view

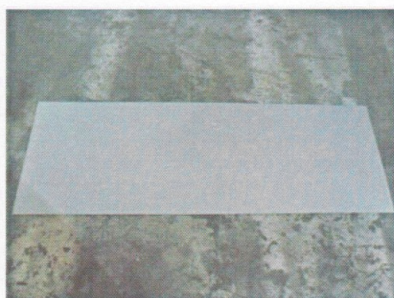

Back view



Section view



Facing coating



Adhesive film



Bottom coating

### REPORT AUTHORIZED

When signed with physical or electronic signature, the contents of this report have been prepared and approved per Intertek's quality process in accordance with ISO 17025.


  
Sally Xie      Tod Qian  
 Name: Sally Xie      Name: Tod Qian  
 Title: Reviewer      Title: Project Engineer

### Revision:

NO.	DATE	CHANGES	AUTHOR	REVIEWER
181030002SHF-001	2018/11/16	First issue	Tod Qian	Sally Xie
181030002SHF-001-R1	2018/12/20	Revise applicant name and brand name as applicant's requirement	Tod Qian	Sally Xie